



**Ontario Clean Water Agency**  
**Agence Ontarienne Des Eaux**

Englehart Drinking Water System

# 2020 ANNUAL/SUMMARY REPORT



Prepared by the Ontario Clean Water Agency  
on behalf of the Town of Englehart

## TABLE OF CONTENTS

<b>INTRODUCTION .....</b>	<b>1</b>
<b>Section 11 - ANNUAL REPORT .....</b>	<b>2</b>
1.0 INTRODUCTION.....	2
2.0 DESCRIPTION OF THE DRINKING WATER SYSYTEM (DWS No. 220000353).....	3
3.0 LIST OF WATER TREATMENT CHEMICALS USED OVER THE REPORTING PERIOD .....	5
4.0 SIGNIFICANT EXPENSES INCURRED IN THE DRINKING WATER SYSTEM.....	5
5.0 DETAILS ON NOTICES OF ADVERSE TEST RESULTS AND OTHER PROBLEMS REPORTED TO & SUBMITTED TO THE SPILLS ACTION CENTER.....	6
6.0 MICROBIOLOGICAL TESTING PERFORMED DURING THE REPORTING PERIOD.....	7
7.0 OPERATIONAL TESTING PERFORMED DURING THE REPORTING PERIOD.....	7
<b>Schedule 22 - SUMMARY REPORTS FOR MUNICIPALITIES .....</b>	<b>13</b>
1.0 INTRODUCTION.....	13
2.0 REQUIREMENTS THE SYSTEM FAILED TO MEET .....	13
3.0 SUMMARY OF FLOWS AND COMPARISON TO REGULATORY LIMITS .....	13
<b>CONCLUSION.....</b>	<b>19</b>

### List of Figures

**Figure 1 – 2020 – Comparison of Treated Water Flows to the Rated Capacity**

**Figure 2 – Historical Water Usage Trends (2016 to 2020)**

### List of Appendices

**APPENDIX A – Monthly Summary of Microbiological Test Results**

**APPENDIX B – Monthly Summary of Operational Data**



## INTRODUCTION

Municipalities throughout Ontario have been required to comply with Ontario Regulation 170/03 made under the *Safe Drinking Water Act* (SDWA) since June 2003. The Act was enacted following recommendations made by Commissioner O'Conner after the Walkerton Inquiry. The Act's purpose is to protect human health through the control and regulation of drinking water systems. O. Reg. 170/03 regulates drinking water testing, use of licensed laboratories, treatment requirements and reporting requirements.

Section 11 of Regulation 170/03 requires the owner to produce an Annual Report. This report must include the following:

1. Description of system & chemical(s) used
2. Summary of any adverse water quality reports and corrective actions
3. Summary of all required testing
4. Description of any major expenses incurred to install, repair or replace equipment

This annual report must be completed by February 28th of each year.

Schedule 22 of the regulation also requires a Summary Report which must be presented & accepted by Council by March 31<sup>st</sup> of each year for the preceding calendar year.


The report must list the requirements of the Act, its regulations, the system's Drinking Water Works Permit (DWWP), Municipal Drinking Water Licence (MDWL), Certificate of Approval (if applicable), and any regulatory requirement the system failed to meet during the reporting period. The report must also specify the duration of the failure, and for each failure referred to, describe the measures that were taken to correct the failure.

The *Safe Drinking Water Act* (2002) and the drinking water regulations can be viewed at the following website: <http://www.e-laws.gov.on.ca>.

To enable the Owner to assess the rated capacity of their system to meet existing and future planned water uses, the following information is also required in the report.

1. A summary of the quantities and flow rates of water supplied during the reporting period, including the monthly average and the maximum daily flows,
2. A comparison of the summary to the rated capacity and flow rates approved in the systems approval, drinking water works permit or municipal drinking water licence or a written agreement if the system is receiving all its water from another system under an agreement.

The reports have been prepared by the Ontario Clean Water Agency (OCWA) on behalf of the Owner and presented to council as the 2020 Annual/Summary Report.

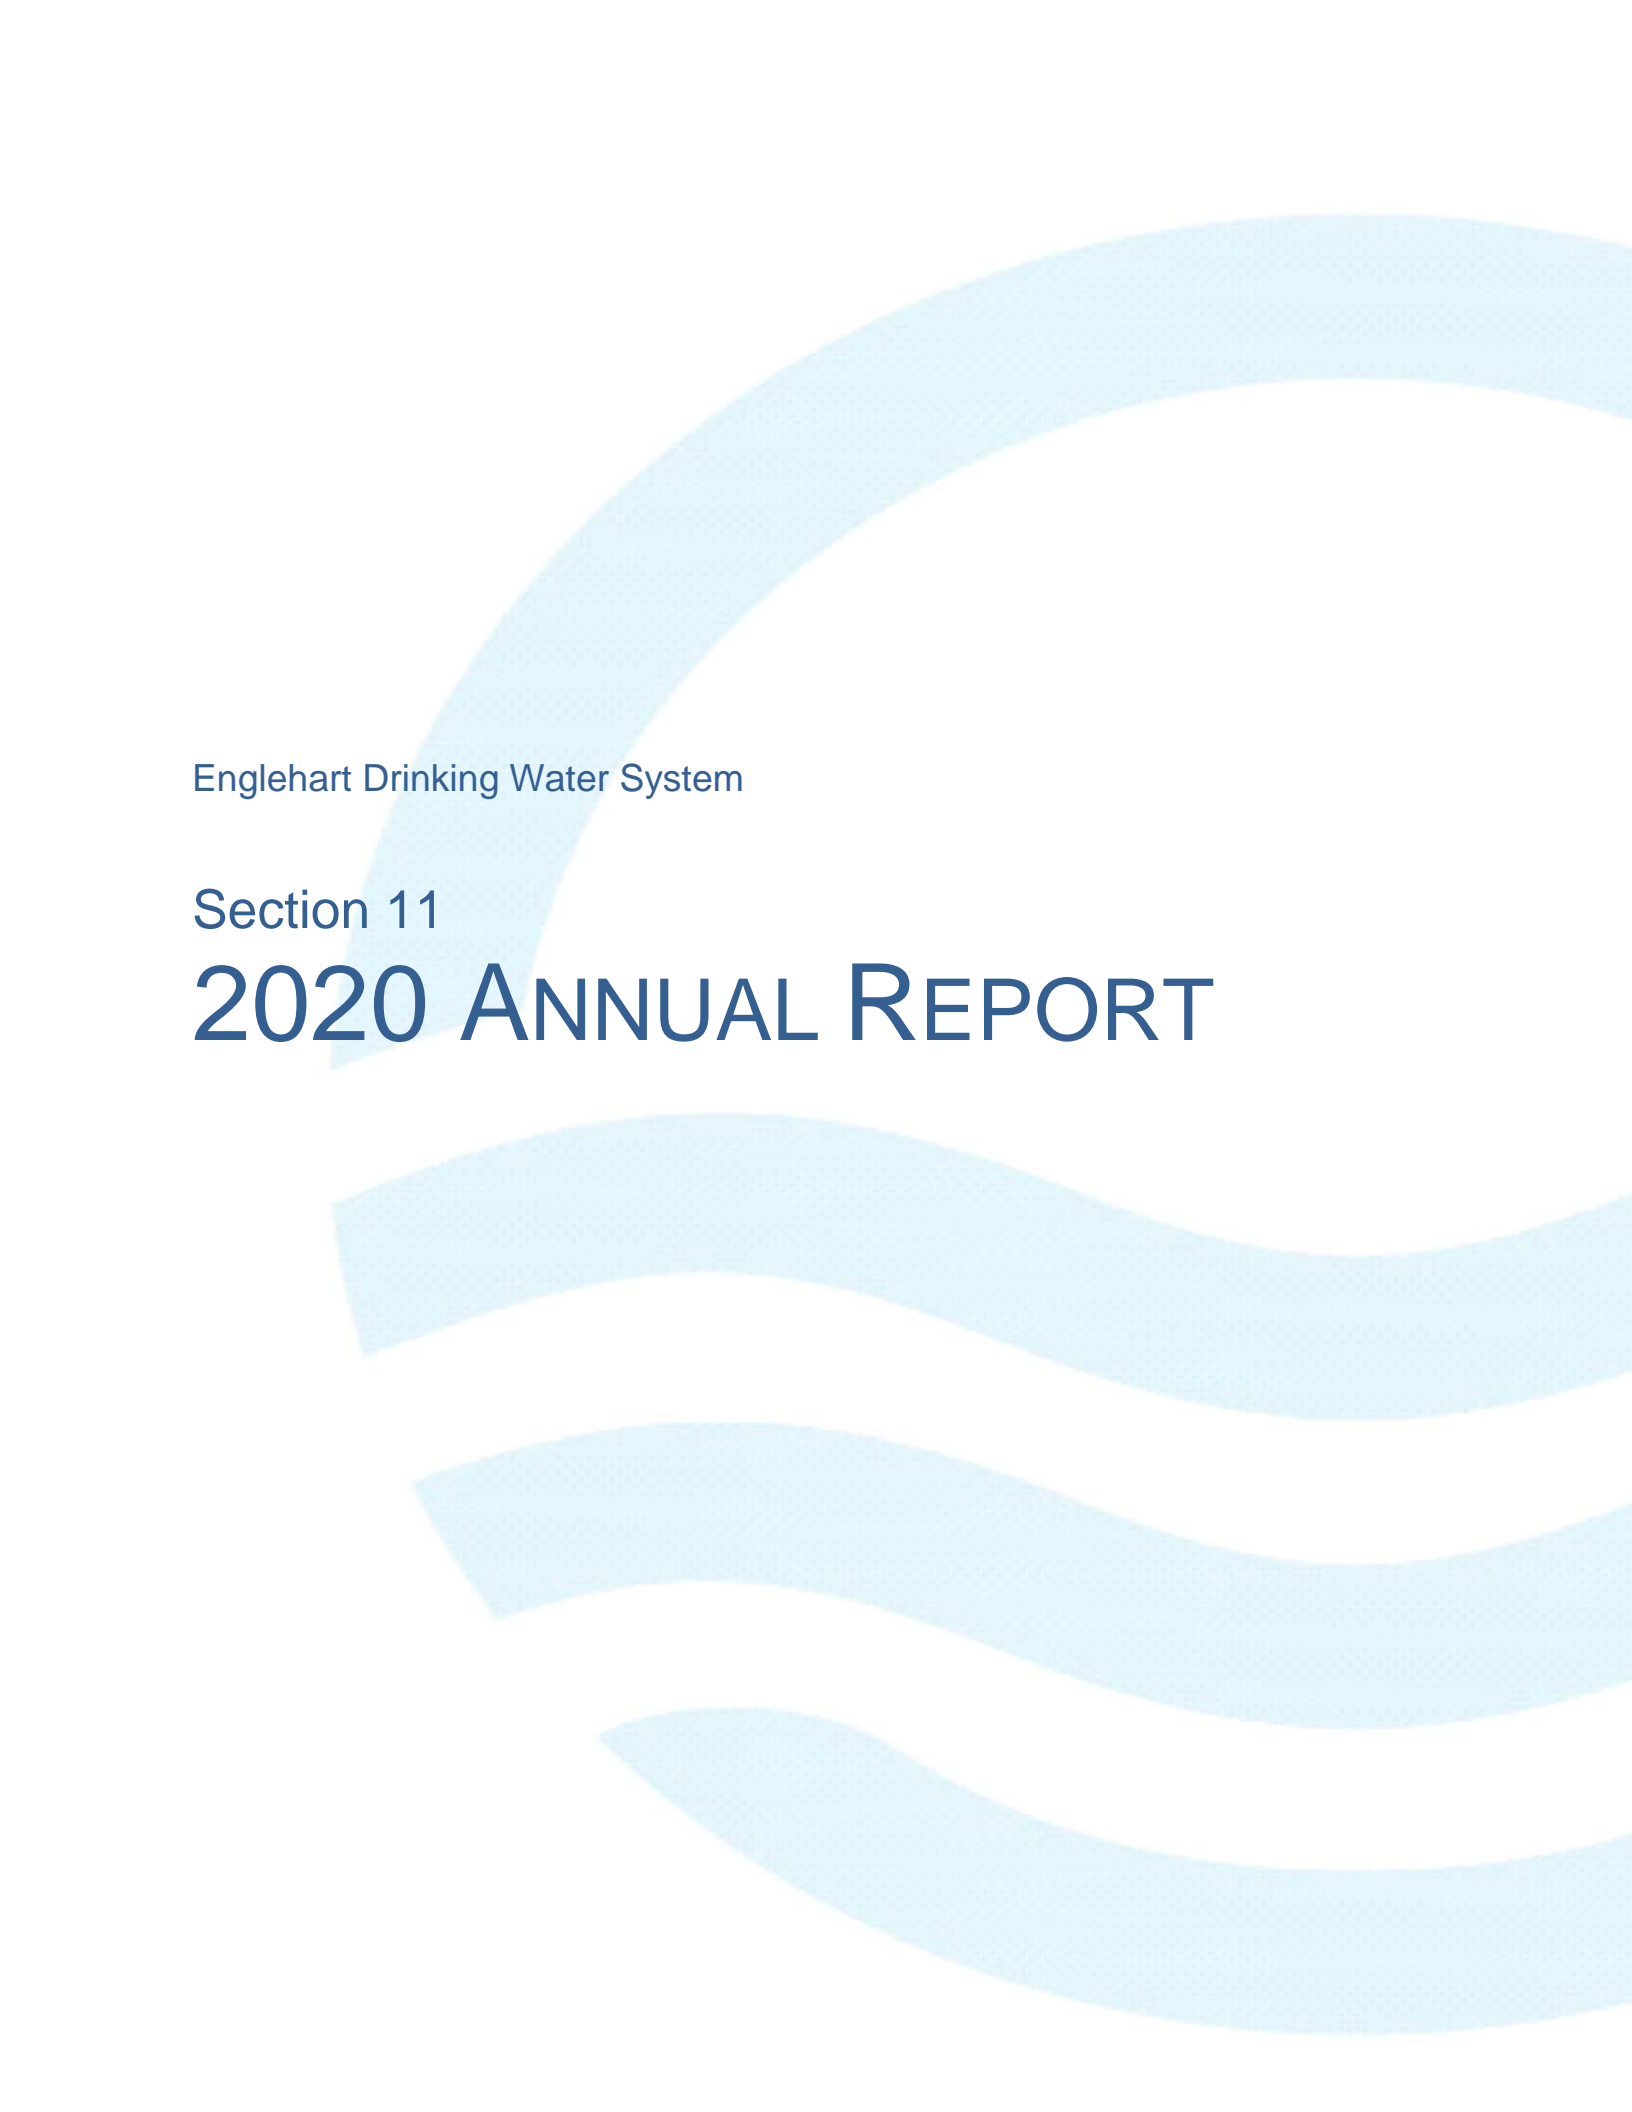

Englehart Drinking Water System

Section 11

# 2020 ANNUAL REPORT



## Section 11 - ANNUAL REPORT

---

### 1.0 INTRODUCTION

**Drinking-Water System Name:** Englehart Drinking Water System  
**Drinking-Water System No.:** 220000353  
**Drinking-Water System Owner:** The Corporation of the Town of Englehart  
**Drinking-Water System Category:** Large Municipal, Residential System  
**Period being reported:** January 1, 2020 to December 31, 2020

**Does your Drinking Water System serve more than 10,000 people?** No

**Is your annual report available to the public at no charge on a web site on the Internet?** Yes  
at <http://www.engehart.ca/>

**Location where the report required under O. Reg. 170/03 Schedule 22 will be available for inspection.**

Englehart Town Office  
61 Fifth Avenue  
Englehart, Ontario POJ 1H0

### ***Drinking Water Systems that receive drinking water from the Englehart Drinking Water System***

The Englehart Drinking Water System provided drinking water to the Town of Englehart and five neighbouring distribution systems:

- |                        |                  |
|------------------------|------------------|
| 1. Bradley Subdivision | DWS #: 260069927 |
| 2. First St North      | DWS #: 260078871 |
| 3. Kap-kig-iwan Road   | DWS #: 260078650 |
| 4. Bryans' Road        | DWS #: 260080574 |
| 5. Brown's Road        | DWS #: 260078663 |

***The Annual Report was provided to all Drinking Water System owners that are connected to the Englehart Drinking Water System.***

The Ontario Clean Water Agency prepared the 2020 Annual/Summary Report for the Englehart Drinking Water System and provided a copy to the system owner; the Town of Englehart. A copy was also provided to the Municipality of Charlton and Dack (Bradley Subdivision) and the following list of representatives for the remaining private lines:



- |    |                      |                   |
|----|----------------------|-------------------|
| 1. | Ms. Cindy Kirkbride  | First St North    |
| 2. | Mr. Len Fisher       | Kap-kig-iwan Road |
| 3. | Ms. Marie Bryan      | Bryans' Road      |
| 4. | Mr. Daryl Rowlandson | Brown's Road      |

***Notification to system users that the Annual Report is available for viewing is accomplished through:***

- Notice via newsletter
- Notice on the Town's Facebook page

## **2.0 DESCRIPTION OF THE DRINKING WATER SYSTEM (DWS No. 220000353)**

The Englehart Drinking Water System is owned by the Corporation of the Town of Englehart and consists of a Class 1 water treatment subsystem and a Class 1 water distribution subsystem. The Ontario Clean Water Agency is the accredited operating authority and is designated as the Overall Responsible Operator for both the water treatment and water distribution facilities. It is a communal ground water well supply that services the Town of Englehart and five neighbouring distribution systems.

### ***Raw Water Supply***

The water treatment plant is located on 56 First Street in Ewanturel Township in the district of Timiskaming and is supplied by two deep-drilled wells; Well No. 2 and Well No. 3.

Well No. 2 is located in a separate well house situated approximately 40 meters south of the treatment plant (approximately 52 m east of 1st Street and 15 m north of 6th Avenue). The well was constructed on July 27, 1948 is drilled to a depth of 89.3 meters. It consists of a stainless steel intake screen and a 400 mm diameter steel casing which reduces to a 200 mm diameter steel casing. It is equipped with vertical turbine pump and fixed-rate control system to pump at the maximum rate of 15.15 L/second. It includes a magnetic flow meter installed on the 100 mm diameter discharge line that directs water into the water treatment plant and has pump-to-waste provisions.

Well No. 3 is located in a separate well house situated approximately 20 meters east of the treatment plant (approximately 75 m east of 1st Street and 53 m north of 6th Avenue). The well was constructed on July 27, 1976 and is drilled to a depth of 90.5 meters. It consists of stainless steel intake screen and a 300 mm diameter casing that later reduces to a 150 mm diameter steel casing. It is equipped with vertical turbine pump and fixed-rate control system to pump at the maximum rate of 18.9 L/second. It also includes a magnetic flow meter installed on the 100 mm diameter discharge line that directs water into the water treatment plant and has pump-to-waste provisions.



### ***Water Treatment***

The production wells feed the main water treatment plant that has a maximum rated capacity of 2488 cubic meters per day ( $m^3/d$ ).

The process consists of a Filtronics Electromedia iron and manganese removal/pressure filtration system rated at 2998  $m^3/d$ . It consists of two reaction vessels; one for sodium hypochlorite and one for sodium bisulphite (which is currently not in use) and one filter tank. Sodium hypochlorite is injected prior to the reaction vessels. It is used as an oxidant for iron and manganese removal and as a disinfectant. Primary disinfection is achieved in the filter system and a 210 foot, 8 inch diameter contact pipe and is continuously monitored using a free chlorine residual analyzer. The system is also equipped with a turbidity analyzer, backwash flow meter and a filter backwash pump. The backwash residue discharges to the sanitary sewer. A treated water flow meter is located on the common header just downstream of the pressure filter system.

The sodium hypochlorite feed system consists of two (2) 1100 L chemical storage tanks with spill containment and two (2) flow paced chemical metering pumps with automatic backup/switch over.

### ***Water Storage and Pumping Capabilities***

The reservoir consists of a twin cell underground clear well with a 3 meter depth and an overall storage volume 1360  $m^3$ . Ammonia sulphate is added before entering the clearwell to produce a combined residual before entering the distribution system. The ammonia sulphate system consists of one 730 liter chemical tank with spill containment and two metering pumps (one duty and one shelf spare).

Each cell is vented and is accessible by an access hatch with ladder. A butterfly valve provides isolation of each cell if required. Two vertical turbine high lift pumps equipped with variable frequency drives (VFDs) direct water into the distribution system, each at a maximum rate of 37.8 L/second. A distribution water flow meter and a continuous total chlorine analyzer are installed on the high lift discharge header.

### ***Emergency Power***

A 150 kW diesel generator is located outside the water treatment building and can maintain all aspects of the operation during a power outage.

### ***Distribution System***

The Englehart Drinking Water System is classified as a Large Municipal Residential Drinking Water System and serves an estimated population of 1700 residents. Information regarding the age of the distribution system indicated that it was originally installed in 1914. The water mains consists primarily of 12, 10, 8, and 6 inch diameter ductile iron constructed pipe with approximately 50 fire hydrants connected to the system to aid in fire protection. Newly installed



sections of watermain consist of new PVC DR18 piping of the same diameter. Residential service connections consist of 1/2, 5/8, and 3/4 inch copper tubing. There are no off site water storage facilities in the system. Additionally, the distribution system does not receive water from other sources but it provides drinking-water to five neighbouring regulated drinking water systems (one small municipal residential system and four non-municipal year-round residential systems) as listed below:

Distribution System	DWS #	Owner/Operating Authority	# of Service Connections
Town of Englehart	220000353	Town of Englehart	750
Bradley Subdivision	260069927	Municipality of Charlton & Dack	49
First St North	260078871	Ms. Cindy Kirkbride	9
Kap-kig-iwan Road	260078650	Mr. Len Fisher	8
Bryan’s Road	260080574	Ms. Marie Bryan	13
Brown’s Road	260078663	Mr. Daryl Rowlandson	12

**Note:**

A Water Supply Agreement between the Corporation of the Town of Englehart and the Corporation of the Municipality of Charlton and Dack came into effect on August 3, 2016. The terms of the agreement allow the Town of Englehart to monitor and sample the Bradley Subdivision System as part of the Englehart System except for lead sampling and testing under Ontario Regulation 170/03, Section 15.1.

**3.0 LIST OF WATER TREATMENT CHEMICALS USED OVER THE REPORTING PERIOD**

The following chemicals were used in the treatment process at the Englehart Water Treatment Plant.

- Sodium Hypochlorite - Disinfection
- Ammonium Sulphate - Chloramination
- Sodium Bisulphite - available at the plant, but is currently not in use.

All treatment chemicals meet AWWA and NSF/ANSI standards.

**4.0 SIGNIFICANT EXPENSES INCURRED IN THE DRINKING WATER SYSTEM**

OCWA is committed to maintaining the assets of the drinking water system and maintains a program of scheduled inspection and maintenance activities using a computerized Work Management System (WMS).

Significant expenses incurred in the drinking water system include:





- Five pneumatic actuators for filter valves were replaced. Original actuators are discontinued.
- Two 1000 litres sodium hypochlorite tanks were replaced with two new storage tanks each having a capacity of 1100 litres.
- Fire hydrant repairs.

**5.0 DETAILS ON NOTICES OF ADVERSE TEST RESULTS AND OTHER PROBLEMS REPORTED TO & SUBMITTED TO THE SPILLS ACTION CENTER**

Based on information kept on record by OCWA, four (4) adverse water quality incidents were reported to the Ministry’s Spills Action Centre in 2020.

Date	AWQI No.	Details
May 11, 2020	149971	<p>Three (3) total coliforms were detected in a drinking water sample collected at the BNS Corner Gas Station in Englehart (334405 - Hwy 11). The sample was collected on May 11<sup>th</sup> at 0950 hours. The combined chlorine residual was 0.91 mg/L.</p> <p><u>Corrective Action:</u> Resamples were collected upstream, downstream and at the site of the adverse result on May 13<sup>th</sup>. Re-sample results indicated no total coliforms, E.coli and less than detectable HPC. Incident resolved on May 15, 2020.</p> <p>Notifications and reports completed as required.</p>
June 15, 2020	149461	<p>Three (3) total coliforms were detected in a drinking water sample collected at the Englehart Motel (334416 - Hwy 11). The sample was collected on June 15<sup>th</sup> at 0910 hours. The combined chlorine residual was 1.71 mg/L.</p> <p><u>Corrective Action:</u> Resamples were collected upstream, downstream and at the site of the adverse result on June 17<sup>th</sup>. Re-sample results indicated no total coliforms, E.coli and less than detectable HPC. Incident resolved on June 19, 2020.</p> <p>Notifications and reports completed as required.</p>
July 27, 2020	150980	<p>Four (4) total coliforms were detected in a drinking water sample collected at the Englehart Motel (334416 - Hwy 11). The sample was collected on July 27<sup>th</sup> at 1115 hours. The combined chlorine residual was 1.34 mg/L.</p> <p><u>Corrective Action:</u> Resamples were collected upstream, downstream and at the site of the adverse result on July 29<sup>th</sup>. Re-sample results indicated zero total coliforms, E. coli.</p> <p>Notifications and reports completed as required.</p>
October 9, 2020	152519	<p>POE sample collected on October 5<sup>th</sup>: Sodium result = 44,400 ug/L (44.4 mg/L); replicate result = 44200 ug/L (44.2 mg/L).</p> <p><u>Corrective Action:</u> Resamples collected on October 9<sup>th</sup>: Resample result = 46700 ug/L (46.7 mg/L). Health Unit (J. Sebesta) notified on Oct. 21<sup>st</sup></p>



## 6.0 MICROBIOLOGICAL TESTING PERFORMED DURING THE REPORTING PERIOD

### Summary of Microbiological Data

Sample Type	# of Samples	Range of <i>E. coli</i> Results (min to max)	Range of Total Coliform Results (min to max)	# of HPC Samples	Range of HPC Results (min to max)
Raw (Well No. 2)	52	0 to 0	0 to 0	0	N/A
Raw (Well No. 3)	52	0 to 0	0 to 0	0	N/A
Treated	52	0 to 0	0 to 0	52	< 10 to 280
Distribution	156	0 to 0	0 to 4*	53	< 10 to > 2000

Maximum Allowable Concentration (MAC) for *E. coli* = 0 Counts/100 mL

MAC for Total Coliforms = 0 Counts/100 mL

“<” denotes less than the laboratory’s method detection limit

“>” denotes greater than the laboratory’s method detection limit

#### Notes:

- One microbiological sample is collected and tested each week from the raw (each well) and treated water supply. A total of three microbiological samples are collected and tested each week from the Englehart distribution system which includes one sample from the Bradley Subdivision. At least 25% of the distribution samples must be tested for HPC bacteria
- \*Three (3) adverse bacteriological results were detected in the Englehart distribution system during the reporting period.
  - May 11 – Three (3) total coliforms were detected in a drinking water sample collected in the distribution system at the BNS Corner Gas Station in Englehart – 334405, Hwy 11. Resamples collected and results acceptable (AWQI No. 149971).
  - June 15 – Three (3) total coliforms were detected in a drinking water sample collected at the Englehart Motel – 334416, Hwy 11. Resamples collected and results acceptable (AWQI No. 150275).
  - July 27 – Four (4) total coliforms were detected in a drinking water sample collected at the Englehart Motel – 334416, Hwy 11. Resamples collected and results acceptable (AWQI No. 150980).

Refer to [Appendix A](#) for a monthly summary of microbiological test results.

## 7.0 OPERATIONAL TESTING PERFORMED DURING THE REPORTING PERIOD

### Summary of Raw Water Turbidity Data

Parameter	# of Samples	Range of Results (min to max)	Unit of Measure
Turbidity (Well No. 2)	27	0.24 to 1.38	NTU
Turbidity (Well No. 3)	27	0.27 to 2.58	NTU

Note: Samples are required once every month.

### Continuous Monitoring in the Treatment Process

Parameter	# of Samples	Range of Results (min to max)	Unit of Measure	Standard
Free Chlorine Residual	8760	0.83 to 5.00	mg/L	CT**



**Notes:**

1. For continuous monitors 8760 is used as the number of samples.
2. \*\* CT is the concentration of chlorine in the water times the time of contact that the chlorine has with the water. It is used to demonstrate the level of disinfection treatment in the water. CT calculations are performed for the Englehart water plant if the free chlorine residual level drops below 0.85 mg/L to ensure primary disinfection is achieved. A CT calculation was performed on March 13<sup>th</sup> and May 19<sup>th</sup> (FCR = 0.83 mg/L) and passed, meaning the system was providing proper disinfection.

**Summary of Chlorine Residual Data in the Distribution System**

Parameter	# of Samples	Range of Results (min to max)	Unit of Measure	Standard
Combined Chlorine Residual	364	0.82 to 2.11	mg/L	≥ 0.25 and <3.0

**Note:** A total of seven operational checks for chlorine residual in the distribution system are collected each week. Four(4) samples are tested one day and three (3) on a second day. The sample sets are collected at least 48-hours apart and samples collected on the same day are from different locations.

Refer to [Appendix B](#) for a monthly summary of the above operational data.

**Summary of Nitrate & Nitrite Data** (sampled at the plant’s point of entry into the distribution every quarter)

Date of Sample	Nitrate Result Value	Nitrite Result Value	Unit of Measure	Exceedance
January 14	< 0.05	< 0.05	mg/L	No
April 14	< 0.05	< 0.05	mg/L	No
July 13	< 0.05	< 0.05	mg/L	No
October 5	< 0.05	< 0.05	mg/L	No

Maximum Allowable Concentration (MAC) for Nitrate = 10 mg/L  
 MAC for Nitrite = 1 mg/L

**Summary of Total Trihalomethane Data** (sampled in the distribution system every quarter)

Date of Sample	Result Value	Unit of Measure	Running Average	Exceedance
January 14	32.7	ug/L	29.0	No
April 14	35.4	ug/L		
July 13	23.5	ug/L		
October 5	24.4	ug/L		

Maximum Allowable Concentration (MAC) for Total Trihalomethanes = 100 ug/L (Four Quarter Running Average)



**Summary of Total Haloacetic Acid Data** (sampled in the distribution system)

Date of Sample	Result Value	Unit of Measure	Running Average	Exceedance
January 14	22	ug/L	14.8	No
April 14	12	ug/L		
July 13	13	ug/L		
October 5	12	ug/L		

Maximum Allowable Concentration (MAC) for Total Haloacetic Acids = 80 ug/L (Four Quarter Running Average)

**Summary of Most Recent Lead Data under Schedule 15.1**

(applicable to the following drinking water systems; large municipal residential systems, small, municipal residential systems, and non-municipal year-round residential systems)

The Englehart Drinking Water System was eligible to follow the “Exemption from Plumbing Sampling” as described in section 15.1-5(9) and 15.1-5(10) of Schedule 15.1 of Ontario Regulation 170/03. The exemption applies to a drinking water system if, in two consecutive periods at reduced sampling, not more than 10% of all samples from plumbing exceed the maximum allowable concentration (MAC) of 10 ug/L for lead. As such, the system was required to test for total alkalinity and pH in two distribution sample collected during the periods of December 15 to April 15 (winter period) and June 15 to October 15 (summer period). This testing is required in every 12-month period with lead testing in every third 12-month period.

Two rounds of lead, alkalinity and pH testing were carried out on March 17<sup>th</sup> and September 23<sup>rd</sup> of 2020. Results are summarized in the table below.

**Summary of Lead Data** (sampled in the Englehart distribution system)

Date of Sample	# of Samples	Field pH (min to max)	Field Temperature (°C) (min to max)	Alkalinity (mg/L) (min to max)	Lead (ug/L) (min to max)
March 17	2	7.42 to 7.65	6.1 to 10.4	254 to 254	< 0.1 to < 0.1
September 23	2	7.00 to 7.05	9.9 to 13.2	245 to 246	0.3 to 0.3

Note: Next lead sampling scheduled for 2023

The Bradley Subdivision Distribution System was also eligible to follow the “Exemption from Plumbing Sampling” as described in section 15.1-5(9) and 15.1-5(10) of Schedule 15.1 of Ontario Regulation 170/03 and in 2019 completed its two rounds of alkalinity and pH testing on March 17<sup>th</sup> and September 16<sup>th</sup>. One distribution sample was required to be tested per period. Results are summarized in the table below.

**Summary of Lead Data** (sampled in the Bradley Subdivision distribution system)

Date of Sample	# of Samples	Field pH	Field Temperature (°C)	Alkalinity (mg/L)	Lead (ug/L)
March 17	1	7.95	5.7	245	0.2
September 16	1	6.81	14	245	< 0.1

Note: Next lead sampling scheduled for 2023



**Most Recent Schedule 23 Inorganic Data Tested at the Water Treatment Plant**

Parameter	Result Value	Unit of Measure	MAC	MAC Exceedance	½ MAC Exceedance
Antimony	< 0.5	ug/L	6	No	No
Arsenic	< 1.0	ug/L	10	No	No
Barium	405	ug/L	1000	No	No
Boron	228	ug/L	5000	No	No
Cadmium	< 0.1	ug/L	5	No	No
Chromium	< 1.0	ug/L	50	No	No
Mercury	< 0.1	ug/L	1	No	No
Selenium	0.8	ug/L	50	No	No
Uranium	< 1.0	ug/L	20	No	No

**Note:** Sample required every 36 months (sample date = October 5, 2020). Next sampling scheduled for October 2023

**Most Recent Schedule 24 Organic Data Tested at the Water Treatment Plant**

Parameter	Result Value	Unit of Measure	MAC	MAC Exceedance	½ MAC Exceedance
Alachlor	< 0.363	ug/L	5	No	No
Atrazine + N-dealkylated metabolites	< 0.5	ug/L	5	No	No
Azinphos-methyl	< 0.272	ug/L	20	No	No
Benzene	< 0.1	ug/L	1	No	No
Benzo(a)pyrene	< 0.01	ug/L	0.01	No	No
Bromoxynil	< 0.105	ug/L	5	No	No
Carbaryl	< 1.0	ug/L	90	No	No
Carbofuran	< 2.0	ug/L	90	No	No
Carbon Tetrachloride	< 0.2	ug/L	2	No	No
Chlorpyrifos	< 0.272	ug/L	90	No	No
Diazinon	< 0.272	ug/L	20	No	No
Dicamba	< 0.092	ug/L	120	No	No
1,2-Dichlorobenzene	< 0.3	ug/L	200	No	No
1,4-Dichlorobenzene	< 0.3	ug/L	5	No	No
1,2-Dichloroethane	< 0.3	ug/L	5	No	No
1,1-Dichloroethylene (vinylidene chloride)	< 0.3	ug/L	14	No	No
Dichloromethane	< 1.0	ug/L	50	No	No
2-4 Dichlorophenol	< 0.2	ug/L	900	No	No
2,4-Dichlorophenoxy acetic acid (2,4-D)	< 0.393	ug/L	100	No	No
Diclofop-methyl	< 0.131	ug/L	9	No	No
Dimethoate	< 0.272	ug/L	20	No	No
Diquat	< 0.2	ug/L	70	No	No
Diuron	< 6.0	ug/L	150	No	No
Glyphosate	< 20.0	ug/L	280	No	No



**Most Recent Schedule 24 Organic Data Tested at the Water Treatment Plant**

Parameter	Result Value	Unit of Measure	MAC	MAC Exceedance	½ MAC Exceedance
Malathion	< 0.272	ug/L	100	No	No
Metolachlor	< 0.182	ug/L	190	No	No
Metribuzin	< 0.182	ug/L	50	No	No
Monochlorobenzene	< 0.5	ug/L	80	No	No
Paraquat	< 0.2	ug/L	80	No	No
Polychlorinated Biphenyls (PCBs)	< 0.06	ug/L	10	No	No
Pentachlorophenol	< 0.3	ug/L	60	No	No
Phorate	< 0.182	ug/L	2	No	No
Picloram	< 0.092	ug/L	190	No	No
Prometryne	< 0.091	ug/L	3	No	No
Simazine	< 0.272	ug/L	1	No	No
Terbufos	< 0.182	ug/L	10	No	No
Tetrachloroethylene	< 0.3	ug/L	1	No	No
2,3,4,6-Tetrachlorophenol	< 0.2	ug/L	30	No	No
Triallate	< 0.182	ug/L	100	No	No
Trichloroethylene	< 0.2	ug/L	230	No	No
2,4,6-Trichlorophenol	< 0.2	ug/L	10	No	No
2-methyl-4-chlorophenoxyacetic acid (MCPA)	< 6.55	ug/L	5	No	No
Trifluralin	< 0.182	ug/L	45	No	No
Vinyl Chloride	< 0.1	ug/L	1	No	No

**Note:** Sample required every 36 months (sample date = October 5, 2020). Next sampling scheduled for October 2023

**Inorganic or Organic Test Results that Exceeded Half the Standard Prescribed in Schedule 2 of the Ontario Drinking Water Quality Standards.**

No inorganic or organic parameter(s) listed in Schedule 23 and 24 of Ontario Regulation 170/03 exceeded half the standard found in Schedule 2 of the Ontario Drinking Water Standard (O. Reg. 169/03) during the reporting period.

**Most Recent Sodium Data Sampled at the Water Treatment Plant**

Date of Sample	# of Samples	Result Value	Unit of Measure	Standard	Exceedance
October 5, 2020	1	44.4	mg/L	20	Yes
October 9, 2020 (resample)	1	46.7	mg/L	20	Yes

**Note:** Sample required every 60 months. Next sampling scheduled for October 2025

The aesthetic objective for sodium in drinking water is 200 mg/L at which it can be detected by a salty taste. It is required that the local Medical Officer of Health be notified when the



concentration exceeds 20 mg/L so that persons on sodium restricted diets can be notified by their physicians. The adverse sodium result was reported to Ministry’s SAC and the Timiskaming Health Unit on October 9, 2020 as required under Schedule 16 of O. Reg. 170/03 (AWQI# 152519).

***Most Recent Fluoride Data Sampled at the Water Treatment Plant***

Date of Sample	# of Samples	Result Value	Unit of Measure	Standard	Exceedance
October 5, 2020	1	0.42	mg/L	1.5	No

**Note:** Sample required every 60 months. Next sampling scheduled for October 2025

***Additional Testing Performed in Accordance with an Approval, Order or Legal Instrument***

No additional sampling and testing was required for the Englehart Drinking Water System during the 2020 reporting period.



Englehart Drinking Water System

Schedule 22

# 2020 SUMMARY REPORT

## FOR MUNICIPALITIES





## Schedule 22 - SUMMARY REPORTS FOR MUNICIPALITIES

---

### 1.0 INTRODUCTION

<b>Drinking-Water System Name:</b>	<b>Englehart Drinking Water System</b>
<b>Municipal Drinking Water Licence (MDWL) No.:</b>	209-101-3 (issued May 19, 2016)
<b>Drinking Water Work Permit (DWWP) No.:</b>	209-201-2 (issued May 19, 2016)
<b>Permit to Take Water (PTTW) No.:</b>	4742-854PPE (expired April 1, 2020) P-300-5072679672 (effective June 3, 2020)
<b>Period being reported:</b>	January 1, 2020 to December 31, 2020

### 2.0 REQUIREMENTS THE SYSTEM FAILED TO MEET

According to information kept on record by OCWA, the Englehart Drinking Water System has complied with all the requirements set out in the system’s MDWL, its DWWP, the Act and its Regulations.

It should be mentioned that, four adverse water quality incidents were reported to the Ministry’s Spills Action Center during the reporting period. Refer to Section 5.0 – *Details on Notices of Adverse Test Results and Other Problems Reported to & Submitted to the Spills Actions Center* on page 6 of this report for details.

### 3.0 SUMMARY OF FLOWS AND COMPARISON TO REGULATORY LIMITS

#### ***Flow Monitoring***

MDWL No. 209-101 requires the owner to install a sufficient number of flow measuring devices to permit the continuous measurement and recording of:

- the flow rate and daily volume of treated water that flows from the treatment subsystem the distribution system, and
- the flow rate and daily volume of water that flows into the treatment subsystem.

The flow monitoring equipment identified in the MDWL is present and operating as required. These flow meters are calibrated on an annual basis as specified in the manufacturers’ instructions.



## Water Usage

The following water usage tables summarize the quantities and flow rates of water taken and produced during the 2020 reporting period, including total monthly volumes, average monthly volumes, maximum monthly volumes, and maximum flow rates.

### Raw Water

#### 2020 - Monthly Summary of Water Takings from the Source (Well No. 2 and Well No. 3)

Regulated by Permit to Take Water (PTTW) #P-300-5072679672 effective June 3, 2020

##### Well No. 2

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year to Date
Total Volume (m <sup>3</sup> )	6196	5156	5683	4988	6340	6022	6366	6723	5999	6754	5738	6269	72234
Average Volume (m <sup>3</sup> /d)	200	178	183	166	205	201	205	217	200	218	191	202	197
Maximum Volume (m <sup>3</sup> /d)	273	218	228	218	446	265	268	268	269	316	245	289	446
PTTW - Maximum Allowable Volume (m <sup>3</sup> /day)	1205	1205	1205	1205	1205	1205	1205	1205	1205	1205	1205	1205	1205
Maximum Flow Rate (L/min)	900	900	900	900	900	900	739	900	900	900	900	900	900
PTTW - Maximum Allowable Flow Rate (L/min)	909	909	909	909	909	909	909	909	909	909	909	909	909

##### Well No. 3

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year to Date
Total Volume (m <sup>3</sup> )	19099	16000	18293	16124	20437	19182	20024	20495	18331	20414	16798	18614	223811
Average Volume (m <sup>3</sup> /d)	616	552	590	537	659	639	646	661	611	659	560	600	611
Maximum Volume (m <sup>3</sup> /d)	844	674	740	708	1431	852	861	822	827	972	726	855	1431
PTTW - Maximum Allowable Volume (m <sup>3</sup> /day)	1591	1591	1591	1591	1591	1591	1591	1591	1591	1591	1591	1591	1591
Maximum Flow Rate (L/min)	1400	1361	1373	1376	1371	1363	1353	1352	1500	1422	1370	1500	1500
PTTW - Maximum Allowable Flow Rate (L/min)	1727	1727	1727	1727	1727	1727	1727	1727	1727	1727	1727	1727	1727

#### Raw Water Total - Combined Water Taking (Well No. 2 and Well No. 3)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year to Date
Total Volume (m <sup>3</sup> )	25295	21156	23876	21112	26777	25204	26390	27218	24330	27168	22536	24883	295945
Average Volume (m <sup>3</sup> /d)	816	730	770	704	864	840	851	878	811	876	751	803	808
Maximum Volume (m <sup>3</sup> /d)	1117	892	962	926	1877	1117	1129	1090	1096	1288	971	1144	1877
PTTW - Maximum Allowable Volume (m <sup>3</sup> /day)	2796	2796	2796	2796	2796	2796	2796	2796	2796	2796	2796	2796	2796

The system's Permit to Take Water #P-300-5072679672 allows the Town to withdraw water at the following rates:



Well No. 2:	1204.69 m <sup>3</sup> /day	909 L/minute
Well No. 3	1591.10 m <sup>3</sup> /day	1727 L/minute
<hr/>		
Total Combined Daily Volume:	2795.79 m <sup>3</sup> /day	

A review of the raw water flow data indicates that the system did not exceed the maximum allowable volumes or maximum flow rates during the reporting period.

Treated Water

**2020 - Monthly Summary of Treated Water Supplied to the Distribution System**

Regulated by Municipal Drinking Water Licence (MDWL) #209-101 - Issue 3, dated May 19, 2016


	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Year to Date
Total Volume (m <sup>3</sup> )	24007	19632	21942	19464	24973	23621	24488	25474	22647	25566	21054	23030	275898
Average Volume (m <sup>3</sup> /d)	774	677	708	649	806	787	790	822	755	825	702	743	753
Maximum Volume (m <sup>3</sup> /d)	994	775	856	772	1684	1037	1020	989	1003	1234	941	967	1684
MDWL/C of A - Rated Capacity (m <sup>3</sup> /day)	2488	2488	2488	2488	2488	2488	2488	2488	2488	2488	2488	2488	2488

Schedule C, Section 1.0 (1.1) of MDWL No. 209-101 states that the maximum daily volume of treated water that flows from the treatment subsystem to the distribution system shall not exceed 2488 m<sup>3</sup>/day. The Englehart DWS complied with this limit having a recorded maximum volume of 1684 m<sup>3</sup>/day on May 29<sup>th</sup>, which represents 67.7% of the rated capacity.

Figure 1 compares the average and maximum flow rates into the distribution system to the rated capacity of the system identified in the MDWL.

**Figure 1: 2020 - Comparison of Treated Water Flows to the Rated Capacity**

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Average Flow (m <sup>3</sup> /day)	774	677	708	649	806	787	790	822	755	825	702	743
Maximum Flow (m <sup>3</sup> /day)	994	775	856	772	1684	1037	1020	989	1003	1234	941	967
MDWL - Rated Capacity	2488	2488	2488	2488	2488	2488	2488	2488	2488	2488	2488	2488
% Rated Capacity	40	31	34	31	68	42	41	40	40	50	38	39

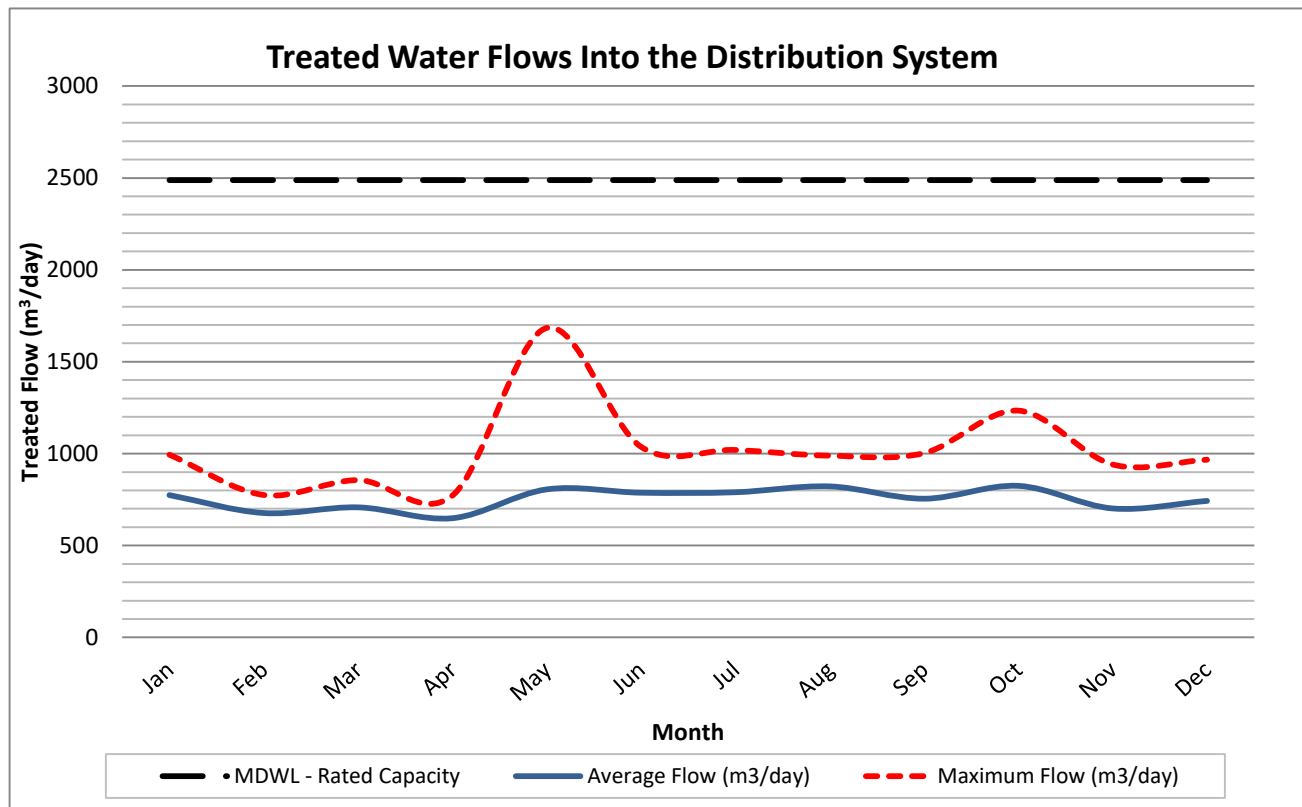



The following information is provided to enable the Owner to assess the capability of the system to meet existing and future water usage needs.

**Summary of System Performance**

Rated Capacity of the Plant (MDWL)	2,488 m <sup>3</sup> /day	
Average Daily Flow for 2020	753 m <sup>3</sup> /day	30.3 % of the rated capacity
Maximum Daily Flow for 2020	1684 m <sup>3</sup> /day	67.7 % of the rated capacity
Total Treated Water Produced in 2020	275,898 m <sup>3</sup>	

**Historical Flows**


**Englehart Water Treatment Plant – Historical Flow Comparison**

Year	Maximum Treated Flow (m <sup>3</sup> /d)	Average Daily Treated Flow (m <sup>3</sup> /d)	Average Day % of Rated Capacity (2488 m <sup>3</sup> /d)
<b>2020</b>	<b>1684</b>	<b>753</b>	<b>30.3%</b>
2019	1714	793	31.8%
2018	1744	830	33.4%
2017	1327	823	33.1%
2016	1629	756	30.4%

Figure 2 compares the average treated water flows from 2016 to 2020.

**Figure 2 - Historical Water Usage Trends (2016 to 2020)**

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
2016 Average Flow (m <sup>3</sup> /day)	607	915	686	744	829	761	834	895	676	779	673	678
2017 Average Flow (m <sup>3</sup> /day)	829	818	781	757	775	846	862	930	911	813	847	702
2018 Average Flow (m <sup>3</sup> /day)	688	794	791	1005	832	884	955	976	777	700	781	776
2019 Average Flow (m <sup>3</sup> /day)	851	711	755	773	646	809	938	951	765	858	702	756
2020 Average Flow (m <sup>3</sup> /day)	774	677	708	649	806	787	790	822	755	825	702	743
MDWL - Rated Capacity (m <sup>3</sup> /day)	2488	2488	2488	2488	2488	2488	2488	2488	2488	2488	2488	2488

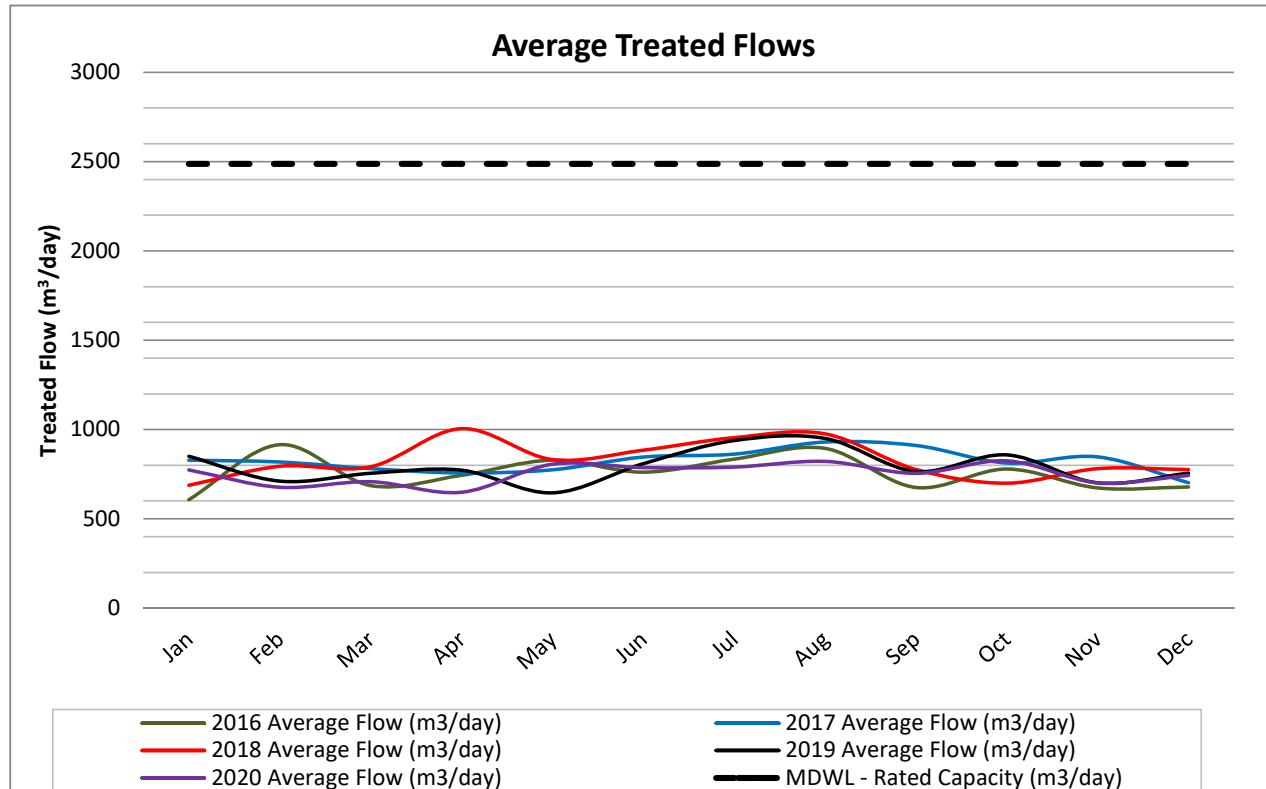



## CONCLUSION

The water quality data collected in 2020 demonstrates that the Englehart drinking water system provided good quality drinking water to its users. Four adverse water quality incidents (three total coliform exceedances and one high sodium incident) occurred in 2020 and were immediately reported, responded to and addressed.

The Englehart Drinking Water System was able to operate in accordance with the terms and conditions of the Permit to Take Water and in accordance with the rated capacity of the licence while meeting the community's demand for water use.



# **APPENDIX A**

Monthly Summary of Microbiological Test  
Results



**ENGLEHART DRINKING WATER SYSTEM  
2020 SUMMARY OF MICROBIOLOGICAL TEST RESULTS**

Facility Works Number: 220000353  
 Facility Owner: Municipality: Town of Englehart  
 Facility Classification: Class 1 Water Treatment

RAW WATER	01/2020	02/2020	03/2020	04/2020	05/2020	06/2020	07/2020	08/2020	09/2020	10/2020	11/2020	12/2020	Total	Avg	Max	Min
<b>Well 2 / Total Coliform: TC - cfu/100mL</b>																
Count Lab	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max Lab	0	0	0	0	0	0	0	0	0	0	0	0			0	
Mean Lab	0	0	0	0	0	0	0	0	0	0	0	0		0		
Min Lab	0	0	0	0	0	0	0	0	0	0	0	0				0
<b>Well 2 / E. Coli: EC - cfu/100mL</b>																
Count Lab	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max Lab	0	0	0	0	0	0	0	0	0	0	0	0			0	
Mean Lab	0	0	0	0	0	0	0	0	0	0	0	0		0		
Min Lab	0	0	0	0	0	0	0	0	0	0	0	0				0
<b>Well 3 / Total Coliform: TC - cfu/100mL</b>																
Count Lab	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max Lab	0	0	0	0	0	0	0	0	0	0	0	0			0	
Mean Lab	0	0	0	0	0	0	0	0	0	0	0	0		0		
Min Lab	0	0	0	0	0	0	0	0	0	0	0	0				0
<b>Well 3 / E. Coli: EC - cfu/100mL</b>																
Count Lab	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max Lab	0	0	0	0	0	0	0	0	0	0	0	0			0	
Mean Lab	0	0	0	0	0	0	0	0	0	0	0	0		0		
Min Lab	0	0	0	0	0	0	0	0	0	0	0	0				0
<b>TREATED WATER</b>																
<b>Treated Water (POE) / Total Coliform: TC - cfu/100mL</b>																
Count Lab	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max Lab	0	0	0	0	0	0	0	0	0	0	0	0			0	
Mean Lab	0	0	0	0	0	0	0	0	0	0	0	0		0		
Min Lab	0	0	0	0	0	0	0	0	0	0	0	0				0
<b>Treated Water (POE) / E. Coli: EC - cfu/100mL</b>																
Count Lab	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max Lab	0	0	0	0	0	0	0	0	0	0	0	0			0	
Mean Lab	0	0	0	0	0	0	0	0	0	0	0	0		0		
Min Lab	0	0	0	0	0	0	0	0	0	0	0	0				0
<b>Treated Water (POE) / HPC - cfu/mL</b>																
Count Lab	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max Lab	< 10	< 10	< 10	< 10	< 10	180	< 10	< 20	< 20	< 280	< 20	70			280	
Mean Lab	< 10	< 10	< 10	< 10	< 10	52.5	< 10	< 12.5	< 14	< 12.5	< 100	< 12	< 25		22.308	
Min Lab	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10			< 10
<b>DISTRIBUTION WATER</b>																
<b>E-3 (Bacti) / Total Coliform: TC - cfu/100mL</b>																
Count Lab	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max Lab	0	0	0	0	0	0	0	0	0	0	0	0			0	
Mean Lab	0	0	0	0	0	0	0	0	0	0	0	0		0		
Min Lab	0	0	0	0	0	0	0	0	0	0	0	0				0
<b>E-3 (Bacti) / E. Coli - cfu/100mL</b>																
Count Lab	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max Lab	0	0	0	0	0	0	0	0	0	0	0	0			0	
Mean Lab	0	0	0	0	0	0	0	0	0	0	0	0		0		
Min Lab	0	0	0	0	0	0	0	0	0	0	0	0				0
<b>E-3 (Bacti) / HPC - cfu/mL</b>																
Count Lab	1	1	3	0	2	1	1	3	1	1	2	2	18			
Max Lab	< 10	< 10	< 40	< 10	< 10	20	20	> 2000	180	< 10	20	40			> 2000	
Mean Lab	< 10	< 10	< 20	< 10	< 10	20	20	> 686.667	180	< 10	< 15	25			> 137.222	
Min Lab	< 10	< 10	< 10	< 10	< 10	20	20	> 10	180	< 10	< 10	10				? 10
<b>E-4 (Bacti) / Total Coliform: TC - cfu/100mL</b>																
Count Lab	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max Lab	0	0	0	0	3	3	4	0	0	0	0	0			4	
Mean Lab	0	0	0	0	0.75	0.6	1	0	0	0	0	0		0.192		
Min Lab	0	0	0	0	0	0	0	0	0	0	0	0				0
<b>E-4 (Bacti) / E. Coli - cfu/100mL</b>																
Count Lab	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max Lab	0	0	0	0	0	0	0	0	0	0	0	0			0	
Mean Lab	0	0	0	0	0	0	0	0	0	0	0	0		0		
Min Lab	0	0	0	0	0	0	0	0	0	0	0	0				0
<b>E-4 (Bacti) / HPC - cfu/mL</b>																
Count Lab	2	1	2	2	1	3	1	1	2	1	1	0	17			
Max Lab	20	60	< 10	< 40	850	< 130	20	50	< 10	10	< 10				850	
Mean Lab	15	60	< 10	< 25	850	< 86.667	20	50	< 10	10	< 10				< 81.176	
Min Lab	10	60	< 10	< 10	850	< 10	20	50	< 10	10	< 10					< 10
<b>E-5 (Bacti) / Total Coliform: TC - cfu/100mL</b>																
Count Lab	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max Lab	0	0	0	0	0	0	0	0	0	0	0	0			0	
Mean Lab	0	0	0	0	0	0	0	0	0	0	0	0		0		
Min Lab	0	0	0	0	0	0	0	0	0	0	0	0				0
<b>E-5 (Bacti) / E. Coli - cfu/100mL</b>																
Count Lab	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max Lab	0	0	0	0	0	0	0	0	0	0	0	0			0	
Mean Lab	0	0	0	0	0	0	0	0	0	0	0	0		0		
Min Lab	0	0	0	0	0	0	0	0	0	0	0	0				0
<b>E-5 (Bacti) / HPC - cfu/mL</b>																
Count Lab	1	2	1	2	1	1	2	1	1	2	2	2	18			
Max Lab	< 10	< 10	< 10	< 10	10	< 10	< 40	40	90	50	< 20	< 50			90	
Mean Lab	< 10	< 10	< 10	< 10	10	< 10	< 25	40	90	< 30	< 15	< 30			< 22.778	
Min Lab	< 10	< 10	< 10	< 10	10	< 10	< 10	40	90	< 10	< 10	< 10				< 10

**NOTES:**  
 \*High HPC count detected in a distribution water sample collected on March 16th. Laboratory confirmed quality control data.  
 \*\* Three adverse water quality incidents (detection of total coliforms) occurred in 2020:  
 1. May 11 – Three (3) total coliforms were detected in a drinking water sample collected in the distribution system at the BNS Corner Gas Station in Englehart – 334405, Hwy 11. Resamples collected and results acceptable (AWQI No. 149971).  
 2. June 15 – Three (3) total coliforms were detected in a drinking water sample collected at the Englehart Motel – 334416, Hwy 11. Resamples collected and results acceptable (AWQI No. 150275).  
 3. July 27 – Four (4) total coliforms were detected in a drinking water sample collected at the Englehart Motel – 334416, Hwy 11. Resamples collected and results acceptable (AWQI No. 150980).



# **APPENDIX B**

Monthly Summary of Operational Data

**ENGLEHART DRINKING WATER SYSTEM  
2020 SUMMARY OF OPERATIONAL TEST RESULTS**

Facility Works Number: 220000353  
 Facility Owner: Municipality: Town of Englehart  
 Facility Classification: Class 1 Water Treatment

RAW WATER	01/2020	02/2020	03/2020	04/2020	05/2020	06/2020	07/2020	08/2020	09/2020	10/2020	11/2020	12/2020	Total	Avg	Max	Min
Well 2 / Turbidity - NTU																
Count IH	2	2	3	2	2	4	2	2	2	2	2	2	27			
Total IH	1.47	1.5	1.4	1.49	0.55	2.83	1.25	1.75	2.74	0.91	1.38	0.99	18.26			
Max IH	0.86	0.85	0.87	0.87	0.31	0.82	0.73	0.88	1.38	0.47	0.72	0.55			1.38	
Mean IH	0.735	0.75	0.467	0.745	0.275	0.708	0.625	0.875	1.37	0.455	0.69	0.495		0.676		
Min IH	0.61	0.65	0.24	0.62	0.24	0.64	0.52	0.87	1.36	0.44	0.66	0.44				0.24
Well 3 / Turbidity - NTU																
Count IH	2	2	3	2	2	4	2	2	2	2	2	2	27			
Total IH	0.92	0.89	2.78	0.93	1.19	4.33	0.84	2.9	3.1	4.08	1.01	1.88	24.85			
Max IH	0.52	0.46	1.26	0.62	0.6	1.44	0.57	1.46	1.57	2.58	0.68	1.3			2.58	
Mean IH	0.46	0.445	0.927	0.465	0.595	1.083	0.42	1.45	1.55	2.04	0.505	0.94		0.92		
Min IH	0.4	0.43	0.61	0.31	0.59	0.31	0.27	1.44	1.53	1.5	0.33	0.58				0.27
<b>FILTERED WATER</b>	<b>01/2020</b>	<b>02/2020</b>	<b>03/2020</b>	<b>04/2020</b>	<b>05/2020</b>	<b>06/2020</b>	<b>07/2020</b>	<b>08/2020</b>	<b>09/2020</b>	<b>10/2020</b>	<b>11/2020</b>	<b>12/2020</b>	<b>Total</b>	<b>Avg</b>	<b>Max</b>	<b>Min</b>
Pressure Filter / Cl Residual: Free-CT (0.85 mg/L) - mg/L																
Max OL	4.999	4.999	4.999	4.999	4.999	4.999	4.999	4.999	4.999	4.999	4.999	4.999			4.999	
Mean OL	1.913	1.754	1.529	1.773	1.653	1.736	1.659	1.839	1.839	1.967	2.029	1.984		1.806		
Min OL	1.13	1.28	0.83	1.15	0.83	0.85	1.6	1.19	1.21	0.85	1.25	0.96				0.83
<b>DISTRIBUTION WATER</b>	<b>01/2020</b>	<b>02/2020</b>	<b>03/2020</b>	<b>04/2020</b>	<b>05/2020</b>	<b>06/2020</b>	<b>07/2020</b>	<b>08/2020</b>	<b>09/2020</b>	<b>10/2020</b>	<b>11/2020</b>	<b>12/2020</b>	<b>Total</b>	<b>Avg</b>	<b>Max</b>	<b>Min</b>
Residual No. 1 / Cl Residual: Combined - mg/L																
Count IH	9	8	9	9	8	9	9	9	8	8	9	9	104			
Max IH	1.92	1.5	1.69	1.9	1.66	1.71	1.82	1.79	1.69	1.98	2.01	2.09			2.09	
Mean IH	1.636	1.407	1.513	1.704	1.329	1.41	1.493	1.639	1.54	1.655	1.729	1.637		1.561		
Min IH	1.44	1.28	1.3	1.5	0.82	0.97	1.17	1.51	1.39	1.21	1.38	0.88				0.82
Residual No. 2 / Cl Residual: Combined - mg/L																
Count IH	9	8	9	9	8	9	9	9	8	8	9	9	104			
Max IH	2.11	1.89	1.64	1.75	1.64	1.7	1.77	1.81	2.03	1.96	2.08	2.03			2.11	
Mean IH	1.751	1.672	1.42	1.68	1.321	1.522	1.478	1.678	1.728	1.776	1.877	1.767		1.64		
Min IH	1.45	1.44	1.17	1.61	0.87	1.23	1	1.55	1.59	1.51	1.69	1.54				0.87
Residual No. 3 / Cl Residual: Combined - mg/L																
Count IH	9	8	9	9	8	9	9	9	8	8	9	9	104			
Max IH	1.87	1.8	1.8	1.94	1.69	1.97	1.76	1.76	1.74	1.95	2.01	2.03			2.03	
Mean IH	1.577	1.508	1.502	1.527	1.473	1.504	1.358	1.617	1.544	1.508	1.824	1.813		1.565		
Min IH	1.34	1.32	1.13	1.32	1.14	0.88	0.95	1.48	1.37	1.1	1.5	1.48				0.88
Residual No. 4 / Cl Residual: Combined - mg/L																
Count IH	4	4	5	4	4	5	4	5	4	4	5	4	52			
Max IH	1.91	1.61	1.51	1.76	1.61	1.8	1.41	1.5	1.68	1.53	1.92	1.95			1.95	
Mean IH	1.74	1.5	1.414	1.565	1.438	1.62	1.303	1.306	1.653	1.31	1.6	1.755		1.514		
Min IH	1.55	1.32	1.3	1.38	1.33	1.48	1.2	1.14	1.61	1.06	1.33	1.62				1.06

**NOTES:**  
 \* CT is the concentration of chlorine in the water times the time of contact that the chlorine has with the water. It is used to demonstrate the level of disinfection treatment in the water. CT calculations are performed for the Englehart water plant if the free chlorine residual level drops below 0.85 mg/L to ensure primary disinfection is achieved. A CT calculation was performed on March 13th and May 19th (FCR = 0.83 mg/L) and passed.